Run 1998-1 Downtime

January 13, 1998 to February 16, 1998

Scheduled User Hours = 703.1

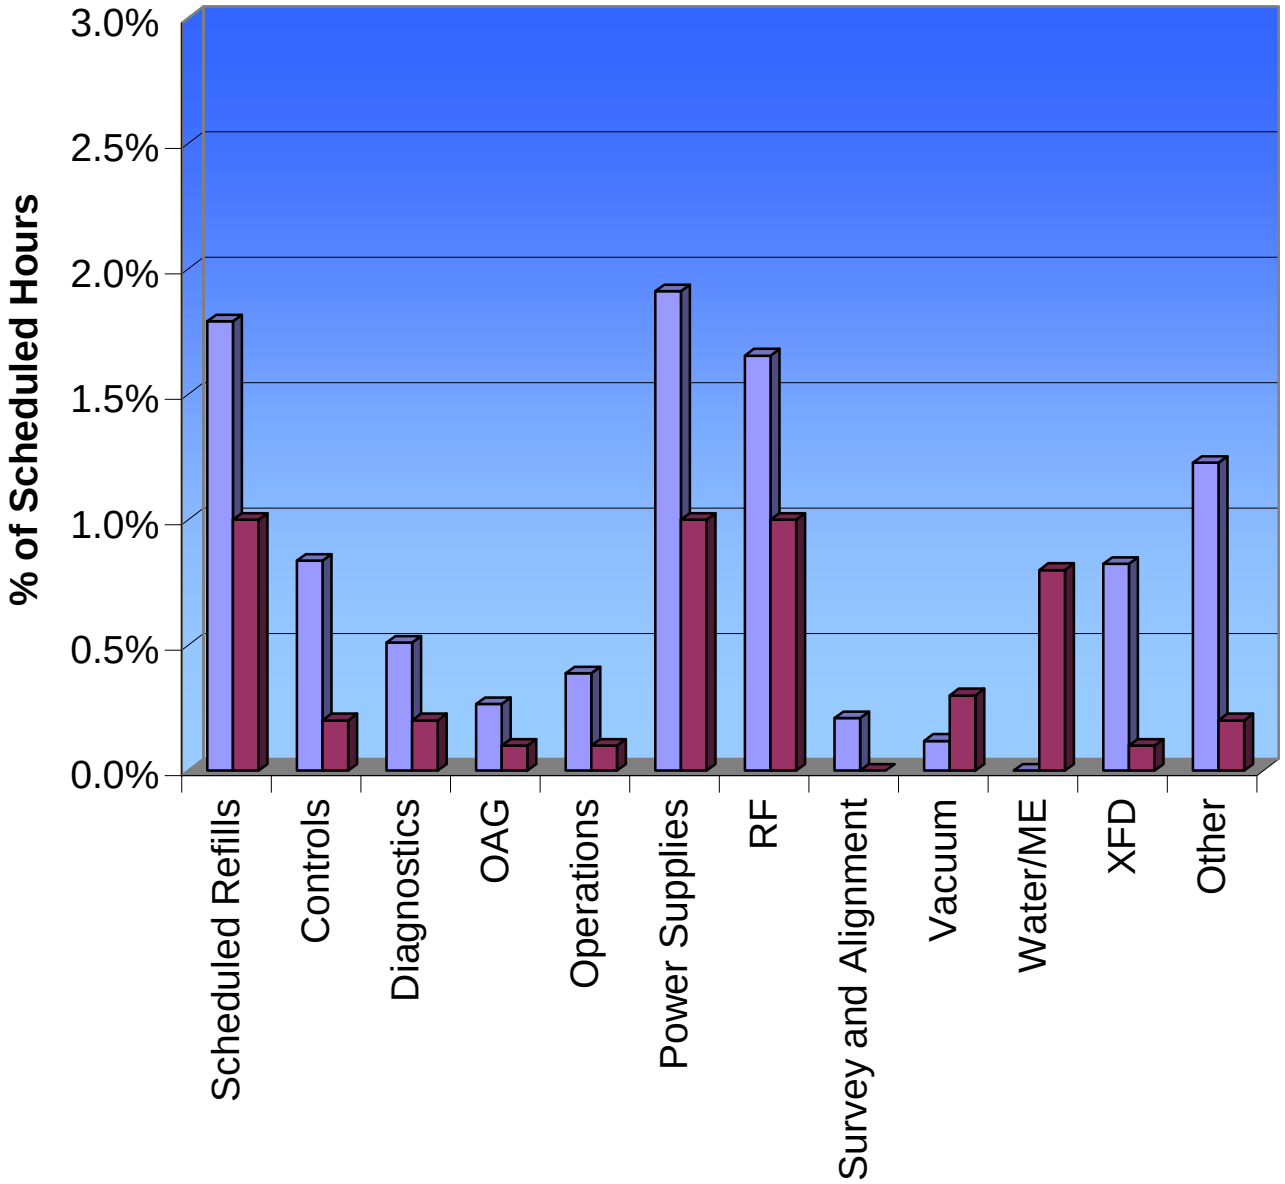

Downtime Budget

1.0% Intentional Refills
0.2% Controls
0.2% Diagnostics
0.1% OAG
0.1% Operations
1.0% Power Supplies
1.0% RF
0.0% Survery & Align.
0.3% Vacuum
0.8% Water/ME
0.1% XFD
0.2% Other

5.0% Total

djc - Downtime Report for Run 1998-1.xls
1998-1 Final 2/19/98 10:41